


#### DRAWING NOTES

1. WIRING INFORMATION IS SUITABLE FOR ENERVEX MBES315x or MBES355x.
2. FOLLOW EQUIPMENT MANUFACTURER'S INSTRUCTIONS FOR PROPER INSTALLATION OF FAN AND CONTROLS. STACK PROBE LOCATION IS JOB SPECIFIC; CONTACT [ENERVEX](http://www.enervex.com) AT 800-255-2923.
3. FOLLOW EQUIPMENT MANUFACTURER'S INSTRUCTIONS FOR PROPER INSTALLATION OF APPLIANCES.
4. THIS PRODUCT IS EQUIPPED WITH AN ELECTRONICALLY COMMUTATED (EC-MOTOR) AND CAN NOT BE CONNECTED DIRECTLY TO AC MAINS. MOTOR MUST BE CONNECTED TO APPROVED MOTOR CONTROLLER TO ENSURE PROPER FUNCTION. FAILURE TO USE APPROVED MOTOR CONTROLLER MAY RESULT IN DAMAGE TO THE MOTOR.
5. DRYER EXHAUST FAN MUST BE LISTED TO UL705 WITH SPECIAL CONSIDERATION FOR LINT LADEN AIR.
6. FOLLOW VENT MANUFACTURER'S RECOMMENDATIONS FOR CORRECT INSTALLATION METHODS.
7. EXHAUST FAN OPERATION SHALL BE MONITORED IN AN APPROVED LOCATION AND SHALL INITIATE AN AUDIBLE OR VISIBLE SIGNAL WHEN THE FAN IS NOT IN OPERATION.
8. FOLLOW ALL PERTINENT NATIONAL, STATE, AND LOCAL CODES FOR PROPER INSTALLATION OF EQUIPMENT AND MATERIAL.

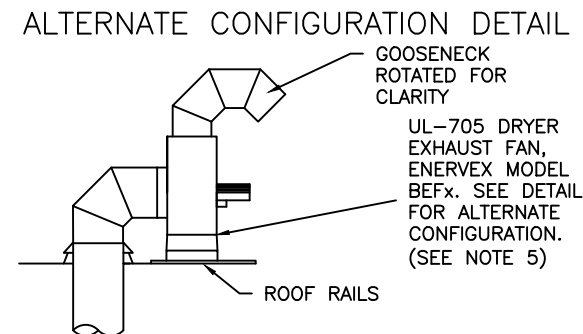

**ENERVEX**

1685 Bluegrass Lakes Pkwy  
Alpharetta, GA 30004, USA  
p. 770-587-3238  
info@enervex.com  
www.enervex.com

INSTALLATION DETAIL FOR A  
MODULATING BUILDING EXHAUST  
SYSTEM (MBES315x-355x)  
120V MEC-24

DIMENSIONAL TOLERANCES (UNLESS NOTED OTHERWISE)			
X	±1	FRACTION	1/16"
XX	±0.5	ANGLE	12°
XXX	±0.05	ROUNDNESS	0.01
SIZE	DRAWING NUMBER		REV
B			A

DATE: 10/11/2016