


DRAWING NOTES

- 1. WIRING INFORMATION IS SUITABLE FOR ENERVEX SMDS APPLICATIONS. SMDS AVAILABLE IN 4”–18” DIAMETER.
- 2. FOLLOW EQUIPMENT MANUFACTURER’S INSTRUCTIONS FOR PROPER INSTALLATION OF FAN AND CONTROLS. STACK PROBE LOCATION IS JOB SPECIFIC; CONTACT ENERVEX, INC. AT 800–255–2923
- 3. FOLLOW EQUIPMENT MANUFACTURER’S INSTRUCTIONS FOR PROPER INSTALLATION OF APPLIANCES.
- 4. FOLLOW VENT MANUFACTURER’S RECOMMENDATIONS FOR CORRECT INSTALLATION METHODS.
- 5. FOLLOW ALL PERTINENT NATIONAL, STATE, AND LOCAL CODES FOR PROPER INSTALLATION OF EQUIPMENT AND MATERIAL.

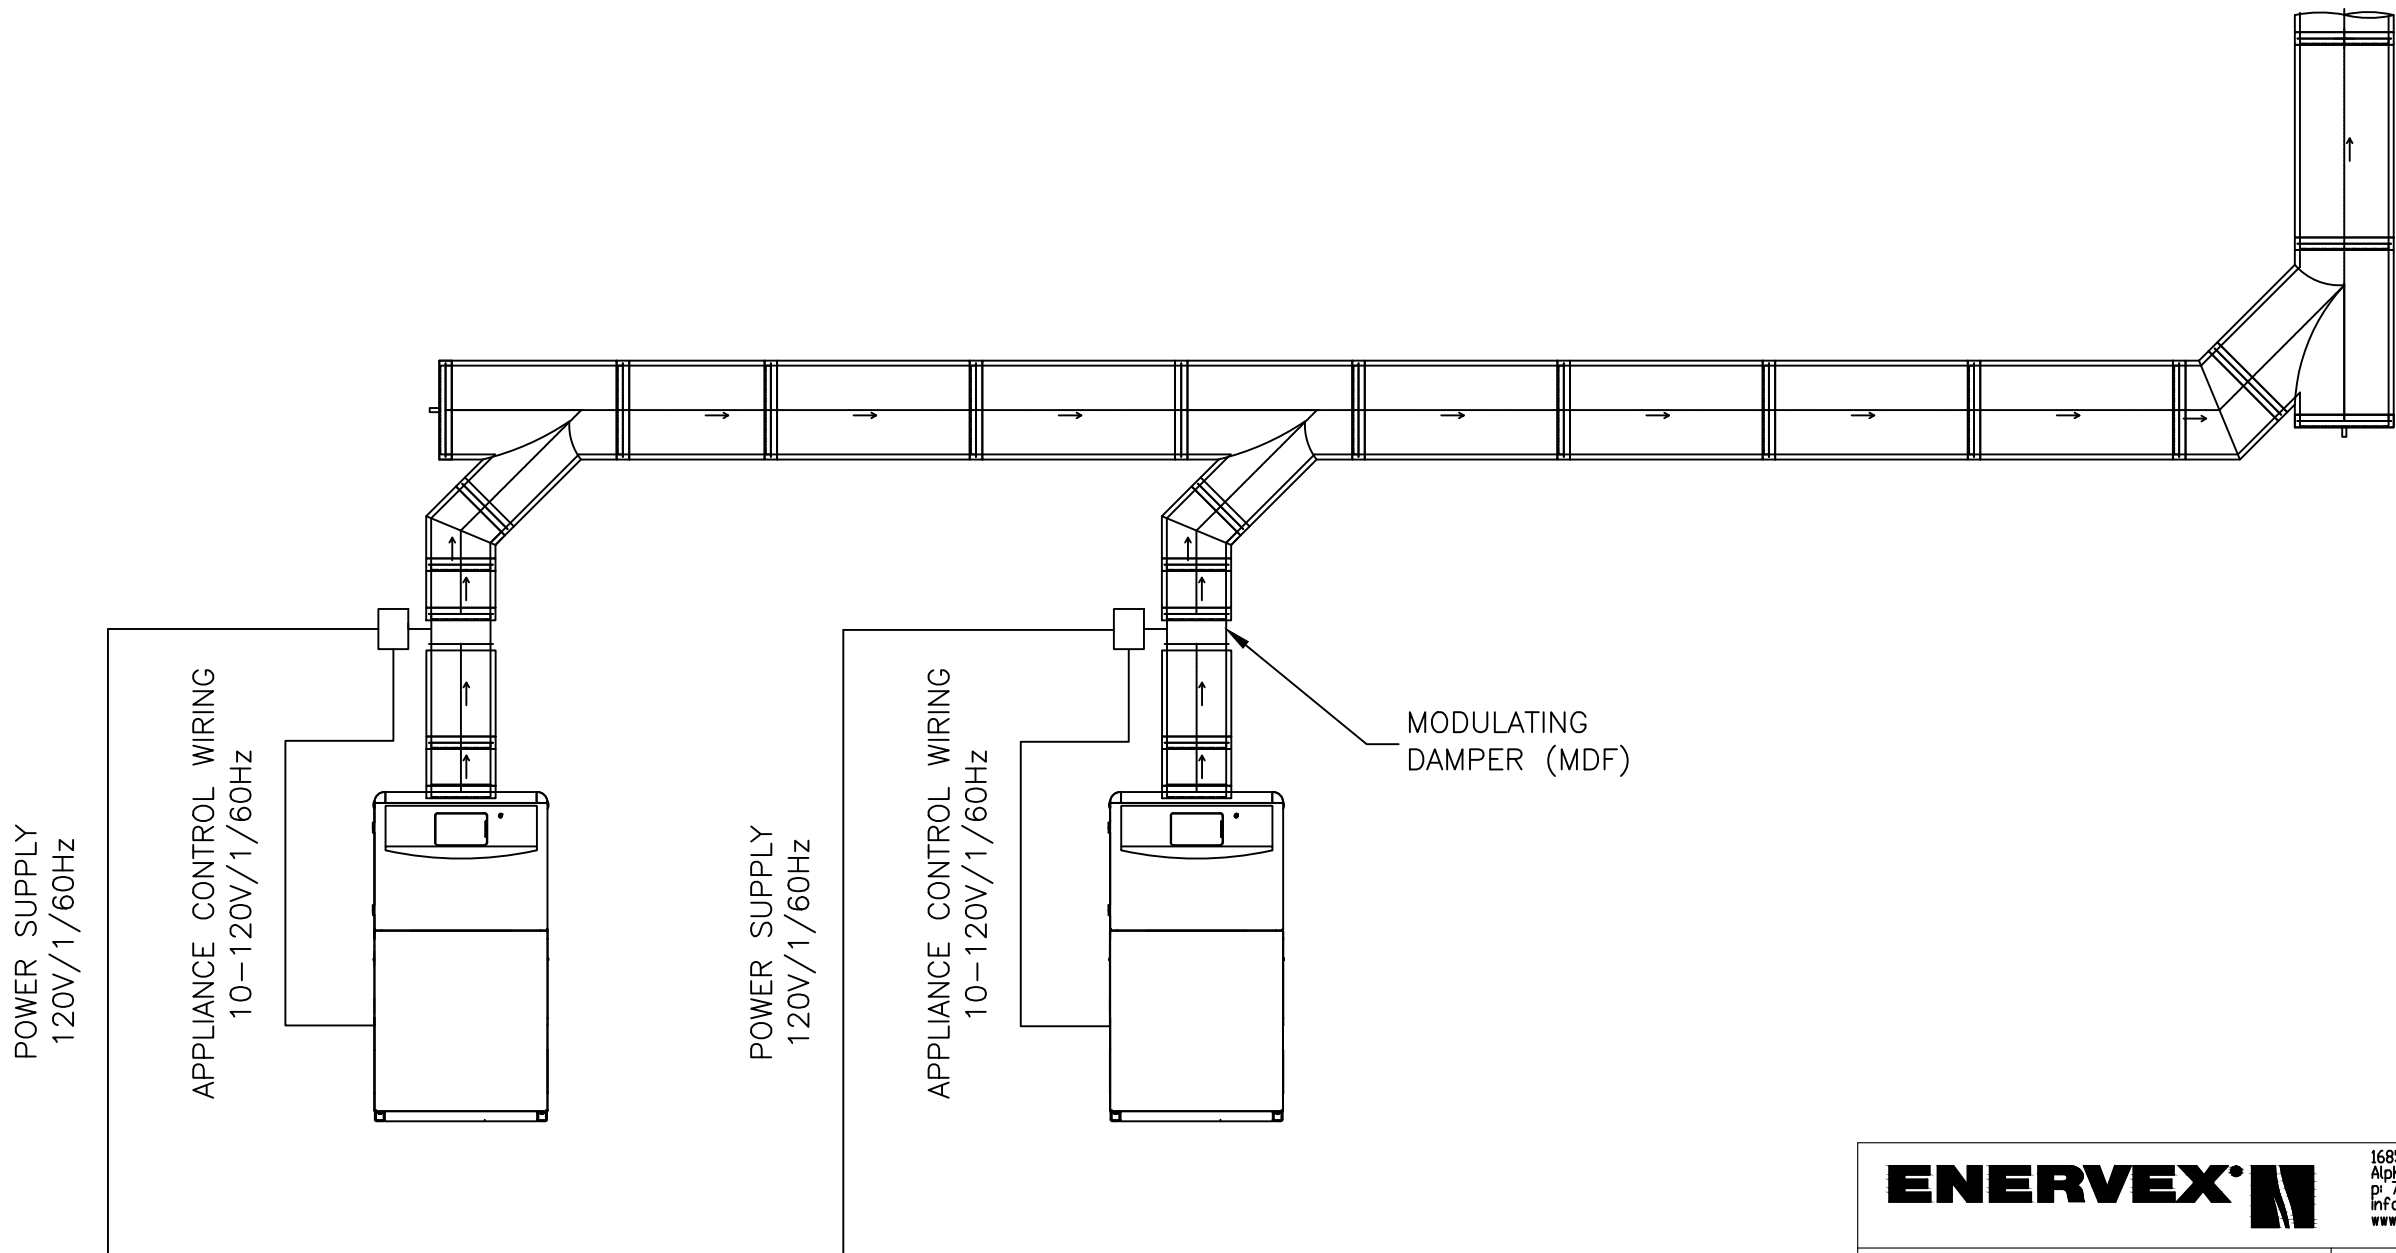

NOTICE: THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND IT SHALL NOT BE USED, REPRODUCED OR ITS CONTENTS DISCLOSED, IN WHOLE OR IN PART, WITHOUT THE EXPRESS WRITTEN CONSENT OF ENERVEX, INCORPORATED.

ENERVEX

1685 Bluegrass Lakes Pkwy
Alpharetta, GA 30004, USA
p. 770-587-3238
info@enervex.com
www.enervex.com

INSTALLATION DETAIL FOR AN
SMDS SYSTEM (04–18")
SINGLE PHASE 120V

DIMENSIONAL TOLERANCES (UNLESS NOTED OTHERWISE)		
X	±1	FRACTION 1/8"
XX	±0.5	ANGLE 12°
XXX	±0.5	ROUNDNESS 0.5
SIZE	DRAWING NUMBER	REV
B		A

DATE: 10/11/2016