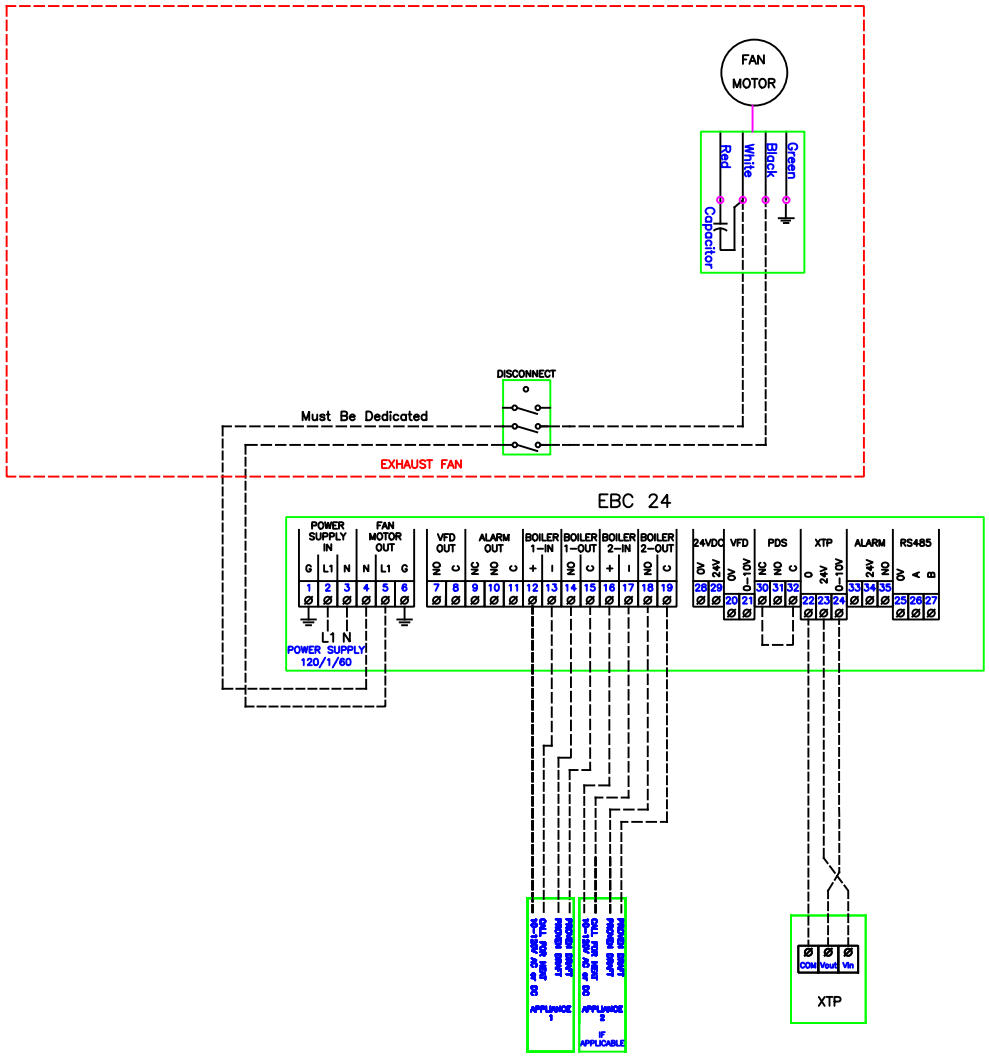

IMPORTANT: POWER TO THE FAN MUST BE PROVIDED BY THE EBC 24.
DO NOT SHARE THE NEUTRAL WIRE FROM THE EBC 24 TO THE FAN.

Note:

The wire sizes shown are typical and may not apply to all jobs. This system must be installed in compliance with the NFPA 70 National Electric Code and/or any local codes.

Not Connected — Connected
Factory Wired — Field Wired

PROPRIETARY AND CONFIDENTIAL

The information contained in this drawing is the sole property of ENERVEX, Inc. Any reproduction in part or as a whole with out the express written consent of ENERVEX, Inc. is prohibited.

NOT TO SCALE

ENERVEX®
GREEN REFORE GREEN WAS IN
1685 Bluegrass Lakes Pkwy
Alpharetta, GA 30004
(770)587-3238
Fax (770)587-4731

TITLE: WIRING DIAGRAM			DATE: 2/2/2024
NAME: EXHAUST ONLY - EBC 24 & GSV 200-315			JOB #: GENERIC
DWG BY: AS	SHEET: 2 OF 2		REV: # 1